

# OCEANAIRE

## AIR BOSS Portable Air-Cooled Spot Cooler

---

ENGINEERING, INSTALLATION AND SERVICE MANUAL



**PAC60**

**PAC12**

**R410A Models**



**OCEANAIRE**

6228 Oakton Street Morton Grove, IL. 60053 Phone 847-583-0311 (or 0317) Fax 847-583-0312  
E-Mail [sales@oceanaire-inc.com](mailto:sales@oceanaire-inc.com) 1-866-GET-AIRE (438-2473) [www.oceanaire-inc.com](http://www.oceanaire-inc.com)

<b><u>TABLE OF CONENTS</u></b>	<b>PAGE</b>
<b>GENERAL DESCRIPTION .....</b>	1
<b>PRODUCT DATA AND SPECIFICATIONS.....</b>	2
<b>UNIT DESCRIPTION</b>	
Standard Features.....	3
Applications / Operation.....	4
Electrical.....	5
Condensate.....	6
Accessories.....	7 - 13
Installation.....	14
Thermostat.....	15
<b>SERVICE</b>	
Replacement Parts Procedure.....	16
Troubleshooting Guide.....	17
Preventive Maintenance.....	18
<b>DIAGRAMS</b>	
Unit Interior.....	19
Piping Schematic.....	20
Wiring Diagrams.....	21 - 26
Use of Extension Cords.....	27
Three Phase Monitor.....	28

**FORWARD**

This manual provides the user with basic details for the installation and operation of the Oceanaire Air Boss spot cooler. It is recommended to read and fully understand the instructions outlined within this manual, before operating the Air Boss unit.

As with all commercial air conditioning equipment, it is recommended to have the Air Boss sized and installed by a licensed specifying engineer and contractor, in accordance with all local and state codes. The length of service received can be extended by following the installation and preventive maintenance instructions.

**NOTICE**

In our ongoing process of continuous improvement, the items and procedures described in this manual are subject to change without notice. Please note model and serial number of the Air Boss unit when contacting the factory.

**GENERAL DESCRIPTION**

The Oceanaire AIRBOSS is a portable air-cooled spot cooler designed for permanent or temporary cooling applications. The entire air conditioning unit has been built in an attractive sheet metal cabinet, equipped with heavy-duty casters for mobility. All Air Boss models come with a 10-foot power cord for electrical connection and added mobility in service. These spot-coolers are designed to direct air to specific areas or objects through a discharge grill located on the upper-front of the unit, while rejecting heat from the top of the unit. The Air Boss models range in cooling capacities from 12,000 BTU/HR to 60,050 BTU/HR to satisfy most space cooling requirements.

The Air Boss is a self-contained unit with the entire cooling system, evaporator and condenser fan motors and electrical components neatly arranged in a gray polyester powder coated metal cabinet. When connected to the proper source of electrical power, a 24-volt thermostat controls the Air Boss unit to provide the desired level of comfort and cooling.

A wide variety of accessories and factory installed options are available for the Air Boss units allowing for improved performance and versatility.



**NOMENCLATURE**

**P AC 24 1 2**



**CAPACITY RATING**

NOMINAL CAPACITY	12.....12,000 BTU/HR
	18.....18,000 BTU/HR
	24.....24,00 BTU/HR
	36.....36,000 BTU/HR
	60.....60,000 BTU/HR

**WARRANTY CARD**


It is important that the warranty card be filled out completely and returned to the factory within fourteen (14) days of installation of the unit in order to receive the benefits of the warranty.

# AirBoss

## Deluxe Air-Cooled Portable Air Conditioners

## SPECIFICATIONS

MODEL: PAC	1211	1811	2412	3612	3632	3634	6012	6032	6034
Cooling Capacity <sup>1</sup>	11,800	16,800	24,020	36,050	36,050	36,050	60,050	60,050	60,050
Voltage (V/Phase) at 60Hz	115/1		208-230/1	208-230/1	208-230/3	460/3	208-230/1	208-230/3	460/3
Cooling Amps <sup>6</sup>	10.4	14.1	14.9	18.1	17.2	8.7	32.0	20.4	14.8
Cooling Watts <sup>6</sup>	1180	1670	2700	3620	3620	3620	6000	6000	6000
In Rush Current (Amps)	77.5	100.5	90	140	122	122	169	140	140
Plug Type	5-15P	5-20P	6-20P	6-30P	L15-30P	L16-20P	6-50P	L15-30P	L16-20P
EER <sup>3</sup>	10.0	10.0	8.9	10.0	10.0	10.0	10.0	10.0	10.0
Compressor HP	1	1 1/2	2	3	3	3	5	5	5
Compressor RLA	9.5	12.3	10.5	13.6	8.8	5.0	27.6	18.1	9.0
Compressor LRA	50	63	48	83	77	35	158	137	62
Evap CFM <sup>4</sup>	400	600	810	1310	1310	1310	1950	1950	1950
Evap Motor HP	1/8	1/8	1/3	1/3	1/3	1/3	1	1	1
Evap Motor Watts	200	210	350	375	375	375	550	550	550
Condenser CFM	580	930	1010	1390	1390	1390	2200	2200	2200
Condenser Motor HP	1/8	1/8	1/3	1	1	1	1	1	1
Condenser Motor Watts	280	450	330	460	460	460	750	750	750
Condensate	5 Gallon Condensate Tank - STANDARD (Pump Optional)						Pump -STANDARD (20 ft. Lift)		
Sound Level <sup>5</sup>	54	60	65		69		78		
R-410A Charge Oz.	18	40	37		66		80		
(A) Height with Casters (in.)	37	44 1/2			51		52		
(B) Width (in.)	20	24			27				
(C) Depth (in.)	25	30			35		39		
(D) Height w/o Casters (in.)	32 1/2	39 1/2			45		46		
Net Weight (lb.)	180	260	260		365	380	485	485	515
Shipping Weight (lb.)	200	285	285		405	420	525	525	555
Shipping Volume (cu. ft.)	19	28			40		48		

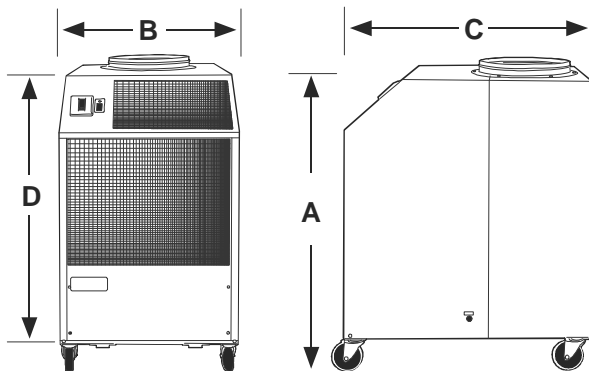

Note: Condenser inlet air plenum adds 13 inches to dimension "C"

### Specifications subject to change without notice

1. Cooling Capacity is total BTUH at 80°DB/67°WB return air, 95°F Outdoor at high fan speed
2. Time Delay fuses/circuit breakers are recommended
3. EER is determined at high fan speed, with condenser discharge air ducted into another area
4. CFM with free discharge
5. Sound Pressure, dB at 5 feet, commercial operation
6. Amps & Watts at 208 Volts

**Ambient operating range 65° to 105°**

May operate down to 55° if equipped with hot gas bypass (Factory installed)

**50 Hz MODELS AVAILABLE - CONSULT FACTORY**

## **STANDARD FEATURES**

### **CABINET**

The AirBoss Series cabinet is constructed of 18 gauge steel with a gray polyester powder coated finish that will compliment any decor. The entire cabinet is insulated with a sound-absorbing insulation for cool, quiet comfort. All units come equipped with handles and swivel casters for portability and convenient set-up.

### **ELECTRONIC THERMOSTAT**

All Air Boss unit are equipped with a non-programmable electronic thermostat. When power is connected to the unit, the thermostat will control the Air Boss to cool a space to the desired temperature. The thermostat is also capable of controlling the fan to operate automatically (when needed) or continuously. To protect the compressor from short-cycling, there is a built-in, 4-minute time delay in the thermostat.

### **FAN SPEED CONTROL**

A two position rocker switch, located next to the thermostat, provides the user with the option of running the evaporator fan in high-speed or low-speed.

### **CONDENSATE RESERVOIR/PUMP**

Air Boss units come equipped with a means for handling the condensate generated during the cooling process. All models **except the 5-ton models** come equipped with a Condensate Reservoir Tank, that captures the condensate from cooling. The tank can then be easily removed from the unit and emptied as required.

The 5-ton Air Boss models come equipped with an Automatic Condensate Pump that disposes of the condensate. The pump comes with a 25 foot long vinyl hose that allows for the disposal of the condensate water to a drain. The automatic pump is capable of a 20ft lift, to handle just about any installation requirement.

### **CONDENSATE ALARM LIGHT**

On the front of all Air Boss models, there is a Condensate Alarm Light (RED) located near the thermostat. For models less than 5-tons, the light indicates that the condensate tank is full and needs to be emptied. In the 5-ton Air Boss units (model PAC60) the light indicates a condensate pump over-flow condition where the pump is either disabled, or incapable of rejecting the condensate water, and must be serviced.

### **FILTERS**

All Air Boss units are equipped with washable filters at the air intakes. 1/8" mesh air filters located behind the evaporator return air grill serve to filter the air before it is cooled. A 1/2" aluminum mesh filter serves to protect the condenser coil from dust build-up. Both filters can be easily removed and cleaned.

### **HIGH PRESSURE SAFETY SWITCH**

Located on the back of the Air Boss unit is a manual re-set high pressure switch, used for the protection of the compressor. If the condensing pressure exceeds the limit setting, the cut-out shuts down the compressor, while the evaporator fan remains running. The compressor can be re-started, once the condensing pressure has lowered, by depressing the "RESET" button.

### **POWER CORDS**

All Air boss units come with power cords, convenient connection and portability. All units except the 5-ton models, and 3-phase models are equipped with LCDI for added safety devices.

## APPLICATIONS

### SPOT COOLER

The Air Boss can be used in an open environment to cool specific objects or "spots". Spot Cooling is a convenient and economical way to provide air conditioning where cooling the entire space is impractical. Cool air is discharged from the unit and is directed where it is needed. Nozzle kits can be used to improve direction of the cooling airflow.


### AREA COOLER

When the Air Boss is installed in an area that is not totally enclosed, the condenser hot air exhaust duct directs condenser air out of the area, allowing the evaporator air to cool the specific space.

### ROOM AIR CONDITIONER

When ducted, the OceanAire AirBoss can be used as a room air conditioner to cool an enclosed space. Using the condenser return air plenum (DCP) and ceiling discharge kit (CK) and ceiling panel kits CK-PL accessories, the Air Boss can operate as a room air conditioner with the condenser air isolated from the conditioned space.

### AIR BOSS—OPERATION / DESCRIPTION

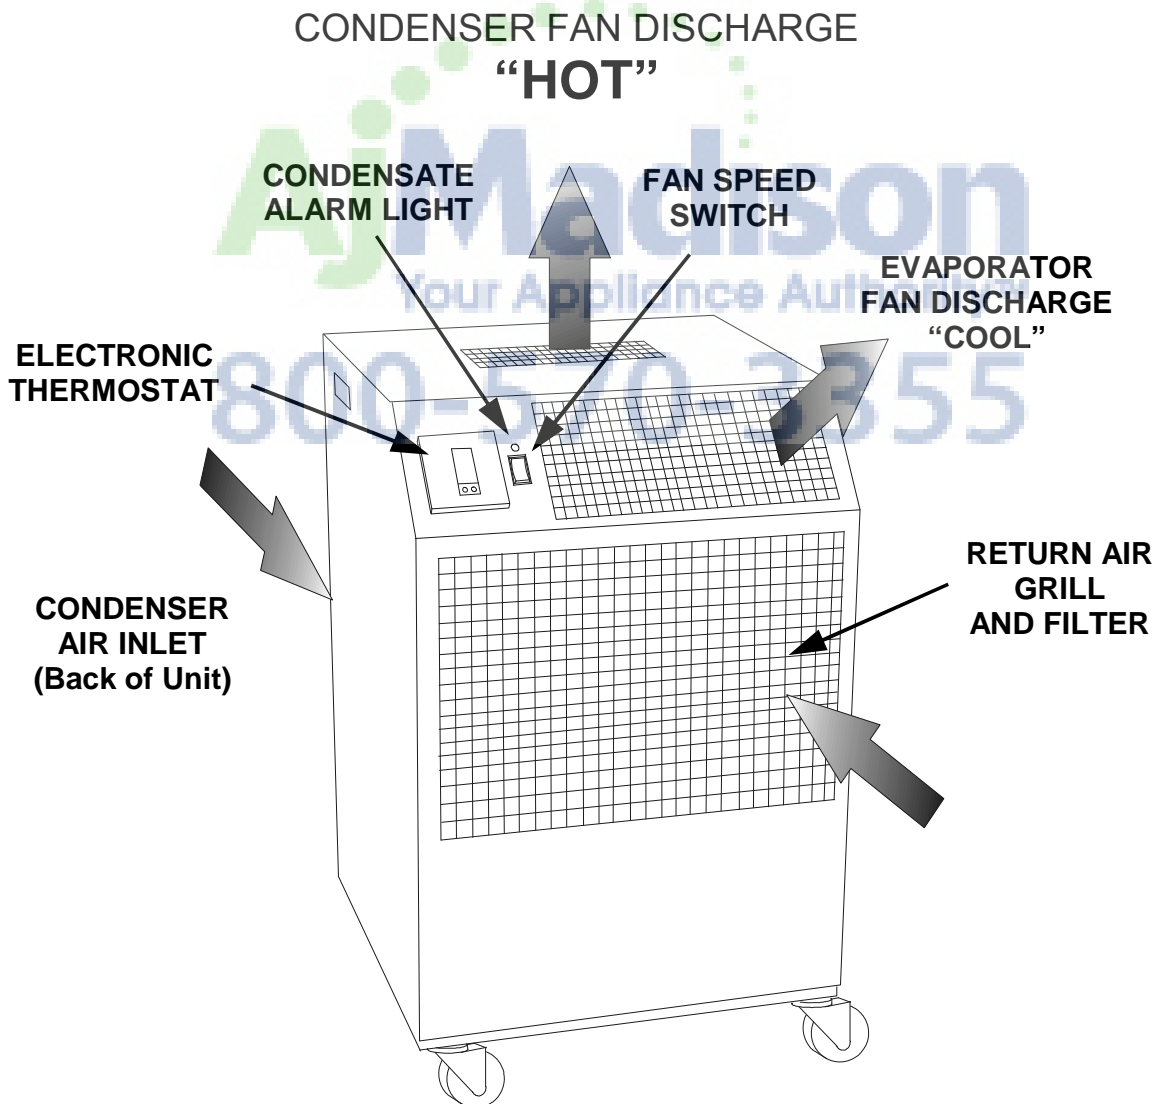

**AIR BOSS—FRONT VIEW**








**SERVICE CORD**

All AirBoss Series units are equipped with the standard ten foot long service cord with plug configurations and receptacle requirements as shown in this chart. PAC1211, PAC1811, PAC2412 and PAC3612 units come with LCDI (Leakage Current Detection & Interruption) devices that serve as a means of electrical protection.

**CAUTION—DO NOT USE THE LCDI AS AN ON/OFF SWITCH FOR THE UNIT**


All 3-phase models are equipped with locking plugs for added connection reliability. Refer to the chart below for plug and receptacle details for all Air Boss models.

**A DAMAGED LCDI POWER SUPPLY CORD MUST BE REPLACED WITH A NEW POWER SUPPLY CORD OBTAINED FROM OCEANAIRE, AND NOT REPAIRED**

UNIT/MODEL	PLUG CONFIGURATION	RECEPTACLE
<u>115 VOLT</u> PAC1211	 15A-125 VOLT NEMA 5-15P	NEMA-5-15R
<u>115 VOLT</u> PAC1811	 20A-125 VOLT NEMA 5-20P	NEMA 5-20R
<u>208-230 VOLT SINGLE PHASE</u> PAC2412	 20A-250 VOLT NEMA 6-20P	NEMA 6-20R
<u>208-230 VOLT SINGLE PHASE</u> PAC3612	 30A-250 VOLT NEMA 6-30P	NEMA 6-30R
<u>208-230 VOLT SINGLE PHASE</u> PAC6012	 50A-250 VOLT NEMA 6-50P	NEMA 6-50R
<u>208-230 VOLT 3-PHASE</u> PAC3632 PAC6032	 30A-250 VOLT NEMA L15-30P	NEMA L15-30R
<u>460 VOLT 3-PHASE</u> PAC3634 PAC6034	 20A-460 VOLT NEMA L16-20P	NEMA L16-20R

## CONDENSATE RESERVOIR TANK

For Air Boss Models PAC12, PAC18, PAC24 and PAC36, a 5-gallon polyethylene tank is provided standard, to collect condensate. The tank is located in the lower, front section of the unit. A high water level cut-out switch is used to stop the compressor and condenser fan automatically when the tank's pre-set water level has been reached. The evaporator fan will continue to run, circulating air.

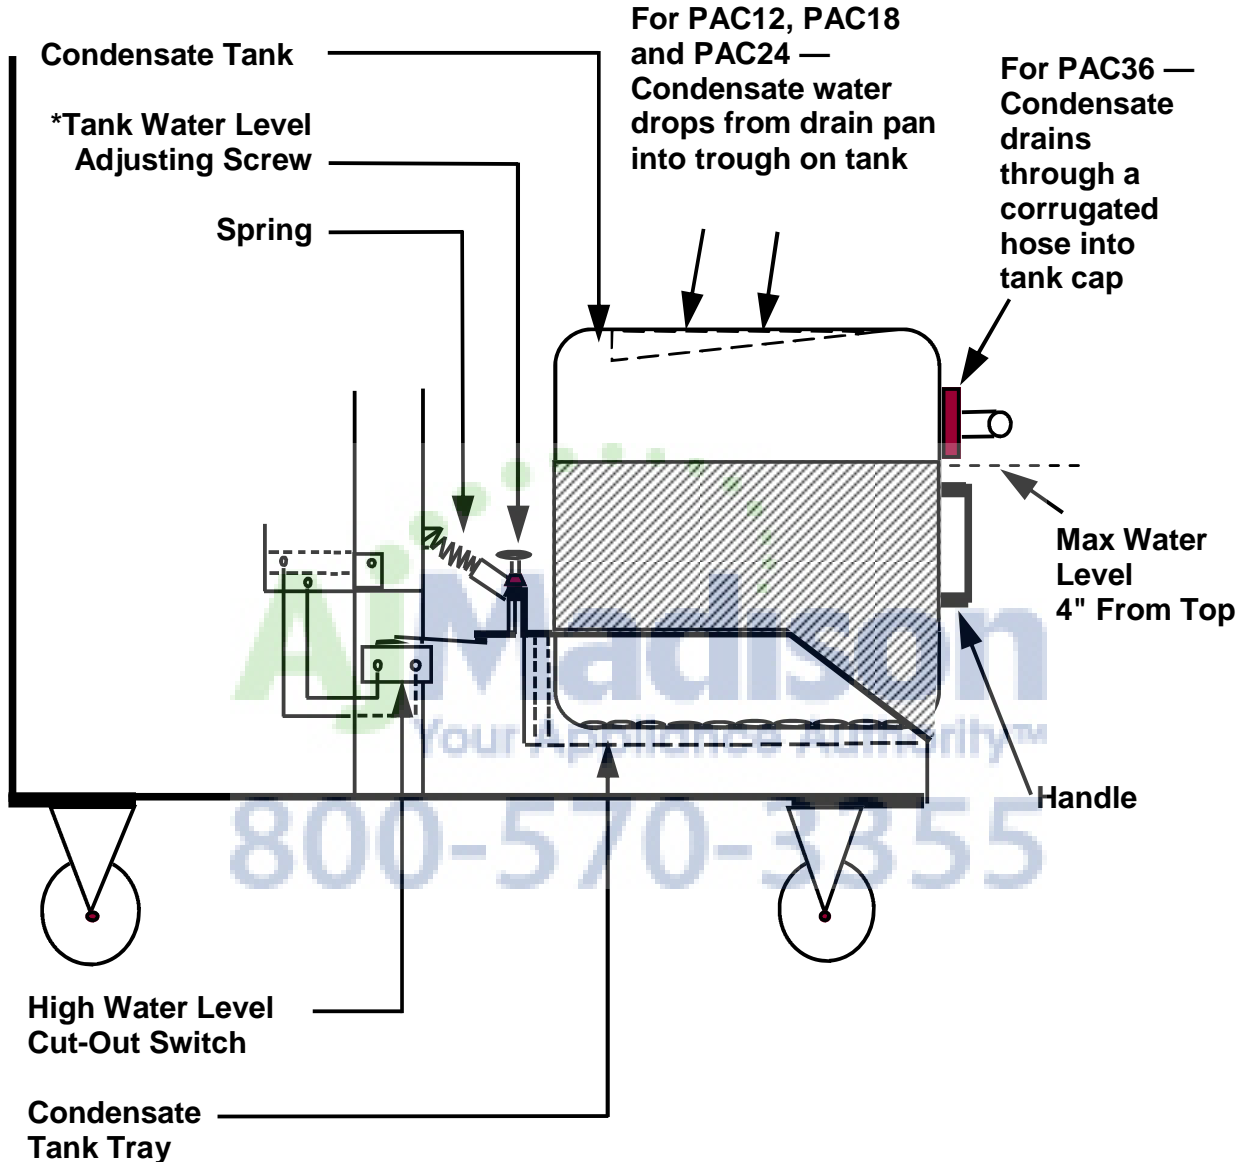

## TANK LEVEL ADJUSTMENT INSTRUCTIONS

An adjustment screw is provided to vary the cut-off of the tank full switch. If a lighter (less weight) level of water is desired, turn the adjusting screw clockwise. Do not exceed 6 full turns counter-clockwise.


CAUTION, TURN UNIT OFF: **BEFORE ADJUSTING SET SCREW**  
**BEFORE REMOVING TANK TO EMPTY CONDENSATE**

Turn screw clockwise to lower water level. Less water makes tank lighter and easier to remove.

NOTE: Max. and Min. water levels shown are those at which the unit will shutdown and not restart until the condensate tank has been drained.



# ACCESSORIES

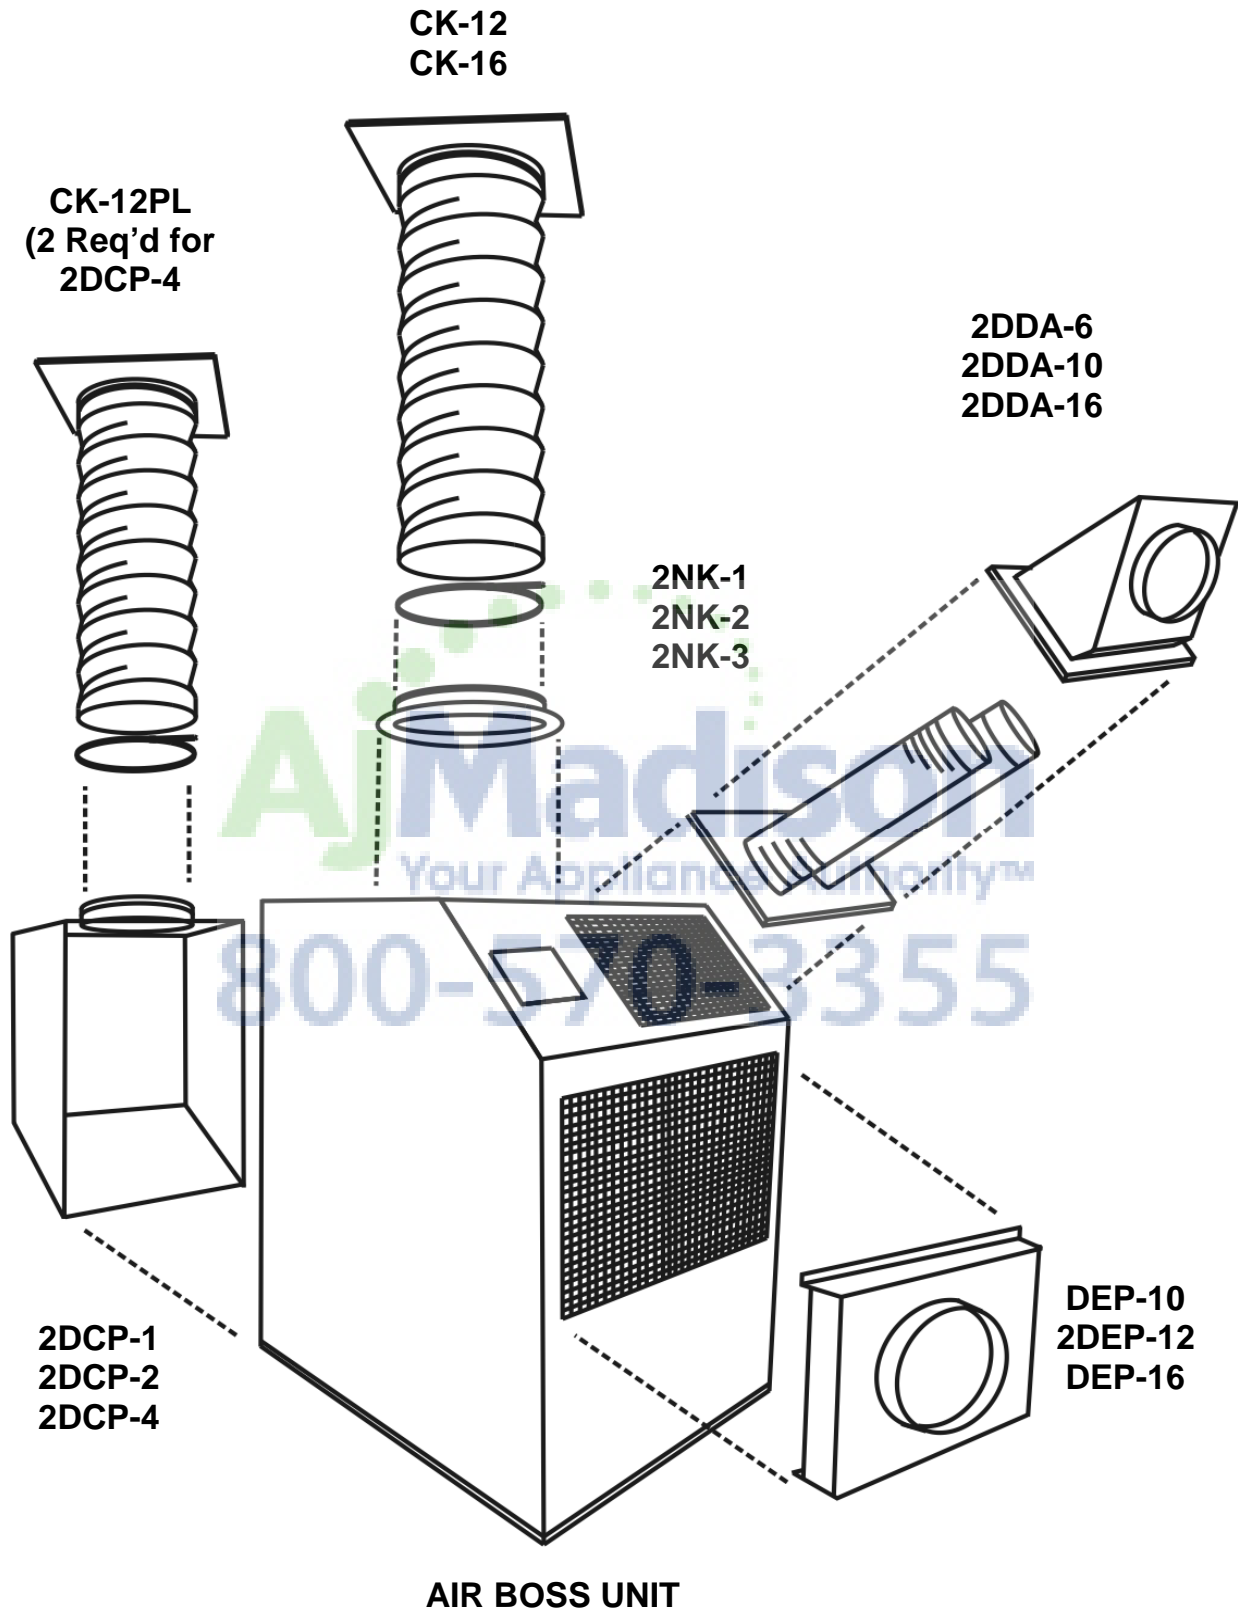

**PAC – AIR BOSS ACCESSORIES**


**NOZZLE KIT**

2NK-1	(2 X 4-Inch)	PAC12
2NK-2	(2 X 6-Inch)	PAC18, 24
2NK-3	(2 X 8-Inch)	PAC36, 60




**EVAPORATOR RETURN AIR PLENUM**

DEP-10	(10-Inch Round)	PAC12
2DEP-12	(12-Inch Round)	PAC18, 24
DEP-16	(16-Inch Round)	PAC36, 60



**DISCHARGE DUCT ADAPTER**


2DDA-6	(6-Inch Round)	PAC12
2DDA-10	(10-Inch Round)	PAC18, 24
DDA-16	(16-Inch Round)	PAC36, 60

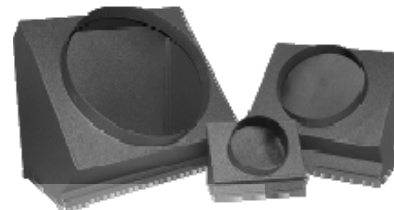

**CONDENSATE PUMP KIT \***

PC-1P	115V Models
PC-2P	230V Models

\* Not Required for PAC60's



**CEILING PANEL KIT**

CK-12	PAC12, 18, 24
CK-16	PAC36, 60
CK-12PL	CK-12 without Duct Flange
CKP-12	2 X 2 Ceiling Panel w/12-Inch Dia. Flange
CKP-16	2 X 2 Ceiling Panel w/16-Inch Dia. Flange




**DUCT FLANGE**

DF-12	12-Inch Duct Flange
DF-16	16-Inch Duct Flange



**CONDENSER RETURN AIR PLENUM**

2DPC-1	PAC12
2DCP-2	PAC18, 24
2DCP-4	PAC60

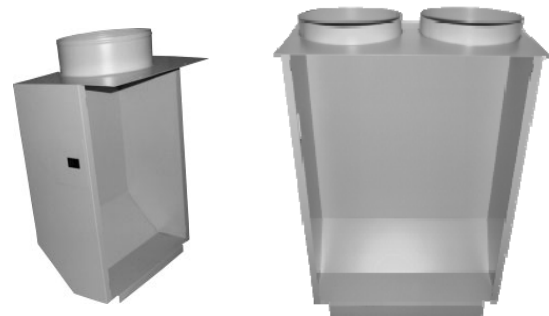

**ACCESSORIES**


**CEILING PANEL DUCT KIT, CK-12, CK-16**

A ceiling panel kit is available for discharging the condenser air above a drop ceiling.. The ceiling panel duct kits are furnished with a white vinyl coated flexible duct that allows for convenient installation. A 2ft X 2ft ceiling duct- panel is included to replace a 2ft X 2ft drop-ceiling panel where the connection is desired.

The CK-12 is available for all Air Boss models except the 5-ton. The ceiling panel kit consists of 8 feet of flexible duct, a 2' X 2' lay in ceiling panel and a 12 inch duct flange that attaches to the condenser air discharge opening on the top of the unit. The CK-16 (for 5-ton units) consists of a ceiling duct-panel, and a 16 inch flexible duct.

**Note—Drop ceiling spaces should be vented or large enough to handle the warm condenser air. Check local codes to assure compliance.**

If longer runs of duct are required, table below lists maximum duct run with no 90° elbows. For every 90° elbow, subtract 6 feet from the run.

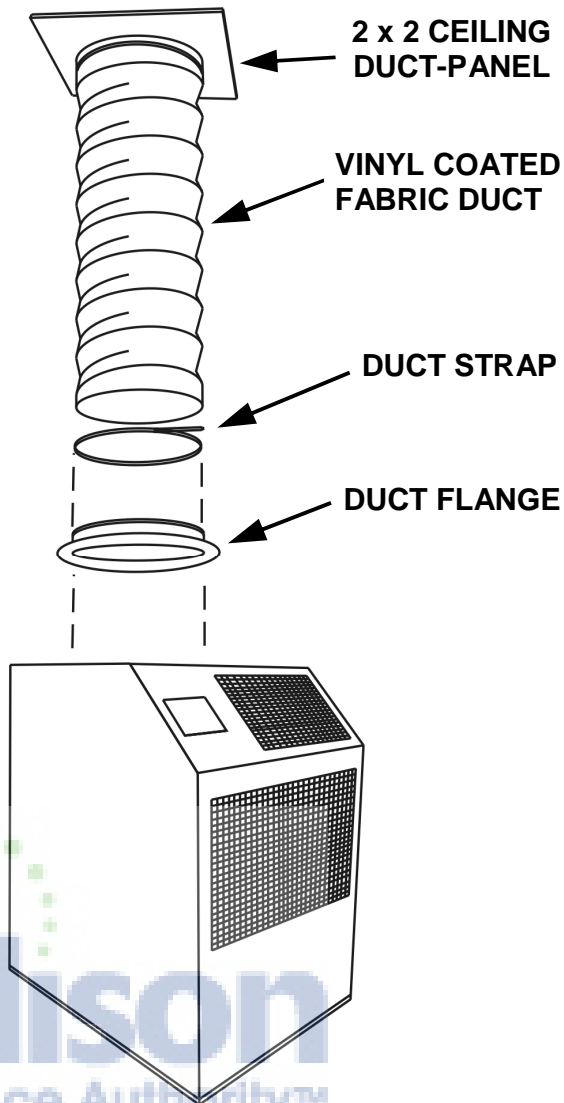

Ceiling Kit Model	Flexible Duct Diameter X Length	Fits PAC12	Fits PAC18	Fits PAC24	Fits PAC36	Fits PAC60
CK-12 Size/Fits	12 inch X 8 feet	✓	✓	✓	No	No
CK-16 Size/Fits	16 Inch X 8 feet	No	No	No	✓	✓
Maximum Approx Equivalent Feet (ESP)		25 (.20)	50 (.25)	50 (.25)	50 (.25)	100 (.50)

**DUCT FLANGE (DF-12, DF-16)**

The optional duct flange allows for round flexible ducting to be attached to the Air Boss condenser discharge. DF-12 (12-inch diameter) fits PAC12, PAC18 and PAC24. The DF-16 (16 inch diameter) fits PAC36 and PAC60.



## **ACCESSORIES**

### **DISCHARGE AIR NOZZLE KIT ASSEMBLY (2NK)**

The optional discharge nozzle kits are used to direct the conditioned air to a specific target area. By concentrating the airflow, the nozzles increase the air velocity towards production lines to cool personnel or equipment. In server rooms, the nozzles can be used to induce airflow through the rack to remove the hot air from the area of the equipment.



**Nozzle Kits**

**2NK-1 for model PAC12**, with (2) 4-inch diameter nozzles with an approximate compressed length of 15 inches. The approximate extended length is 21 inches.

**2NK-2 for models PAC18, PAC24** with (2) 6-inch diameter nozzles with an approximate compressed length of 22 inches. The approximate extended length is 32 inches.

**2NK-3 for PAC36 and PAC60**, with (2) 8-inch diameter nozzles with an approximate compressed length of 20 inches. The extended length is approximately 29 inches.

The nozzle kits come pre-assembled with the nozzles secured to a mounting plate, and with edge guards. By removing the Air Boss discharge grill, one can insert the nozzle kit into the opening without the use of tools.



### **CONDENSATE PUMP KIT: PC-1P and PC-2P**

A plug-in condensate pump kit is available for applications where emptying the 5 gallon condensate tank is not desired. The pump kit consists of a condensate pump with mounting hardware and electrical connections, along with the tubing required for the drain and discharge of the condensate water.



The condensate pump provides for the automatic removal of condensate water during the cooling process. The pump is capable of pumping against a 20 foot head, allowing for the routing of the drain line above the drop-ceiling to a nearby drain. The pump is controlled by an internal float-switch which turns the pump on and off automatically. The pump is also equipped with a condensate over-flow safety switch, that will shut down the Air Boss compressor when the pump is not working properly.

#### **PARTS LIST**

- (1) Condensate Pump with mounting hardware
- (1) 3/8-inch drain hose, 25 ft
- (2) Mounting screws
- (1) Drain hose — black corrugated
- (2) Hose clamps

<u>Kit</u>	<u>Voltage</u>
PC-1P	115V
PC-2P	208-230V


***Plug-in kit is for models with serial number G4 or higher (Oct. 2003).***

**ACCESSORIES**

**CONDENSER RETURN AIR PLENUM, 2DCP**

Condenser return air plenums are available for installations where it is required to duct air to the inlet of the condenser. The plenum easily attaches with one screw to the back of the unit, and is provided with flange(s) for connecting 12-inch flexible ducting. A condenser return air plenums can substantially reduce air noise and allows the unit to operate without drawing condenser air from the conditioned space. Refer to the table below for configuration and application information.

***NOTE — When installing the condenser return air plenum with the ceiling panel kits, allow for a minimum separation distance of 2 feet between the unit discharge duct and the return air duct(s). It is also recommended to direct the condenser discharge air away from the condenser return air ducts.***

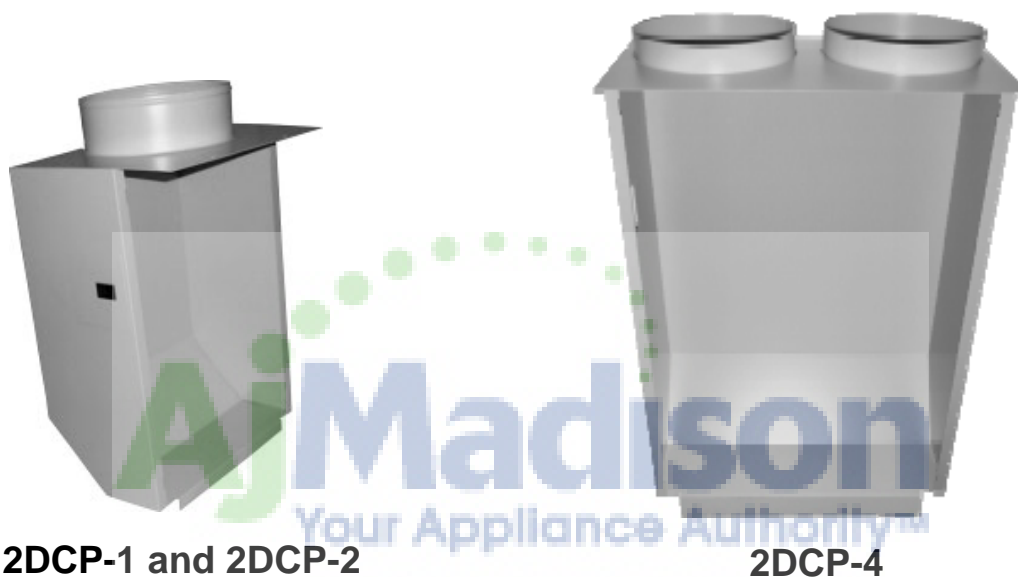

To estimate the “equivalent feet” of condenser duct, add the length of the condenser intake duct run and the length of the condenser discharge duct run, and add 6 equivalent feet per bend in the duct. Make sure that you do not exceed the rated E.S.P. to avoid shut down due to the high pressure cut-out

Plenum Kit	Duct/Flange	PAC12	PAC18	PAC24	PAC36	PAC60
2DCP-1	12-inch	✓				
2DCP-2	12-inch		✓	✓		
2DCP-4	(2) 12-Inch				✓	✓
Maximum Approximate Equivalent Feet		25	50	50	50	100
Estimated External Static Pressure		(.20)	(.25)	(.25)	(.25)	(.50)

## ACCESSORIES

### EVAPORATOR RETURN AIR PLENUM, DEP


Evaporator return air plenums are available for installations where it is required to duct air to the inlet of the evaporator. The evaporator return air plenums allow the user to connect round duct (flexible or rigid) to the return air intake to reduce air noise and increase the number of options for solving difficult cooling problems. The plenum attaches to the front of the unit, replacing the return air grill. Refer to the table below for configuration and application information

**DEP-10 for PAC12** transitions the return air opening to 10-inch round duct.

**2DEP-12 for PAC18 and PAC24** transitions the return opening to a 12-inch round duct.

**DEP-16 for PAC36 and PAC60** transitions the return opening to a 16 inch round duct.

**NOTE—When a DEP is installed, it is recommended to set the evaporator blower speed to high, to avoid evaporator freeze-up.**

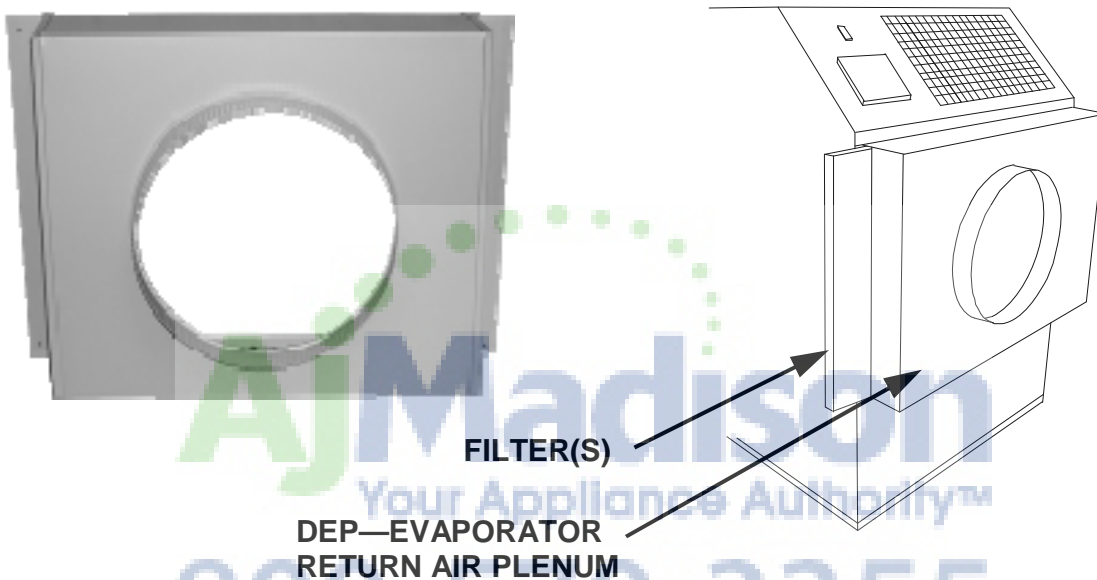

Plenum Kit Duct/Flange	PAC12	PAC18	PAC24	PAC36	PAC60	FILTERS
DEP-10 10 inch	✓					(1) 10"X20"X1"
2DEP-12 12 inch		✓	✓			(1) 15"X25"X1"
DEP-16 16 inch				✓	✓	(1) 12"X30"X1" (1)15"X30"X1"
Maximum Equivalent Feet	25	50	50	50	100	
Est. External Static Pressure	(.20)	(.25)	(.25)	(.25)	(.50)	

**ACCESSORIES**

**Discharge Duct Adapter, 2DDA AND DDA**

Discharge duct adapters are available for applications where ducted evaporator discharge is required. The adapters can be easily installed on the unit without fasteners, and be installed for either vertical or horizontal ducting. The standard discharge grille is removed and the DDA is attached in the grill opening.

**2DDA-6 for PAC1211**, converts the evaporator discharge to a 6-inch diameter round duct.

**2DDA-10 for PAC1811 and PAC2412**, converts the evaporator to a 10-inch diameter round duct.

**2DDA-16 for PAC36 and PAC60** models, converts the evaporator discharge to a 16-inch round duct.

When used in conjunction with the evaporator return air plenum, DEP, the unit can provide closed-loop cooling to and from a given space without the influence of any outside air.



Adapter Model	Round Duct Size	PAC12	PAC18	PAC24	PAC36	PAC60
2DDA-6	6-inch	✓				
2DDA-10	10-inch		✓	✓		
2DDA-16	16-inch				✓	✓
Maximum Approx Equivalent Feet		25	50	50	50	100
Maximum E.S.P		.15	.25	.25	.25	.50

## INSTALLATION INSTRUCTIONS

### **RECEIVING—INSPECTION:**

Upon receiving your Air Boss unit, inspect the packaging for any damage. All units are shipped on a skid, and packaged in a triple-wall carton for added protection. In shipment, some wear may occur on the packaging. If the packaging is heavily damaged or broken, file a claim with the freight company immediately. Carefully unpack the unit and remove all wrapping materials. Save all documentation and fill out the Warranty Card and mail it to Oceanaire.

### **BEFORE INSTALLING**

Check the air conditioner/spot cooler for any damage. All Oceanaire products are thoroughly inspected at the factory and carefully packaged. If any damage is evident, file a claim with the delivering carrier immediately.

### **ELECTRICAL REQUIREMENTS**

Check the nameplate located on the back of the unit to make certain that the proper power is available for the unit. Refer to "Specifications" section for voltage and amperage requirements. For proper NEMA receptacles, refer to "Electrical service plug configuration". When using extension cords, use the properly sized cord as specified, and check cord voltage to the unit.

**TIME DELAY FUSES/CIRCUIT BREAKERS ARE RECOMMENDED**

**800-570-3355**

**WARNING—OPERATING THE UNIT ON  
IMPROPER VOLTAGE WILL VOID THE  
WARRANTY**

### **ACCESSORIES**

Verify that all accessories are correct for the model, and that they installed in accordance with all instructions.

### **START-UP**

Install the unit in accordance with all local and state building codes, and install all accessories. Allow for a clearance around the unit for future maintenance and/or service. Level unit and lock casters, when available. Connect power and test the LCDI on the power cord (if available). Power up unit, via thermostat and check for proper operation. Refer to Thermostat Operation for more details.



## THERMOSTAT OPERATION

### FAN

When the power is connected, the LCD screen on the thermostat will illuminate. Pressing the FAN button once, will turn on the evaporator fan blower. To turn the blower off, push the FAN button once again.

### COOLING MODE \*


To operate unit for cooling, push MODE button to display COOL in the window.

Push down arrow button multiple times to lower set point to desired temperature.

The display will show the set-point temperature for 5 seconds, then it will return to room temperature display.

After a slight pause, the fan motor and compressor will start, beginning the cooling cycle.

Remember, the set-point must be lower than the room temperature for the unit to start.

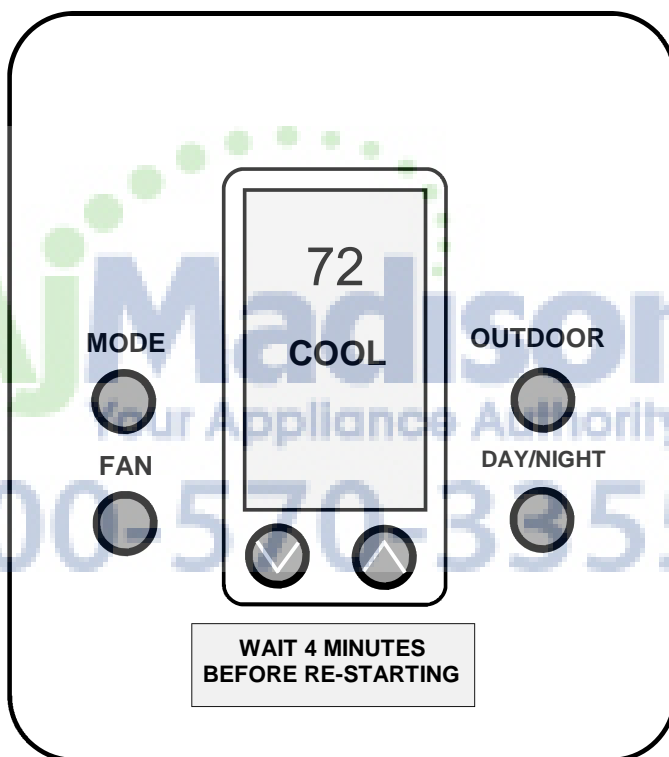

**The OUTDOOR and DAY/NIGHT buttons are not used and do not effect unit operation.**

This is a cooling only thermostat. Select the temperature you want by pressing the ▲ or ▼ buttons. The word COOL and the temperature set-point is displayed for 5 seconds.

To change display to Celsius, simultaneously press the ▲ and ▼ buttons. Press them again to change back to Fahrenheit.

No batteries are required. In the event of a power failure, when the power is restored the thermostat will continue operating as if the power had never been off.

Compressor short cycle protection is built-in to the thermostat. A 4-minute time delay will protect the unit.

## REPLACEMENT PROCEDURE FOR PARTS

**IT IS RECOMMENDED THAT ALL OCEANAIRE UNITS BE SERVICED BY A LICENSED TECHNICIAN**

**WARNING—TO AVOID INJURY, DISCONNECT UNIT POWER PRIOR TO SERVICING**

### **A. FAN MOTORS**

1. Remove cabinet's left-side panel (when looking at the front of the unit).
2. Evaporator fan motor—disconnect evaporator motor wires from evaporator fan contactor and fan speed rocker switch. Condenser fan motor—disconnect condenser motor wires from condenser fan contactor.
3. **For all model sizes 12, 18 and 36**, remove the screws securing motors and inlet-ring to blower housings (all screws are external and visible), and remove blower wheel-motor assembly. Remove the blower wheel set screw and disassemble the blower wheel from the motor shaft and remove the motor.  
**For models size 60**—loosen blower wheel shaft set screw, and remove the screws securing the motor mount to the blower housing and remove motor and mount. Remove the motor from the motor mount.
4. Install the new motor, reversing the removal procedure.

### **B. THERMOSTAT (NO BATTERIES REQUIRED)**

1. Pull up from the bottom of the thermostat to remove it from the mounting sub-base, by gently prying up on the face plate in the slot at the base of the thermostat. Make sure small thermistor located in the bottom of the thermostat for temperature sensing, is not bent or damaged.
2. To remove the thermostat sub-base, remove the 2 mounting screws and the 3 wires (red/yellow/green or red/white black). Make sure the 3 wires do not fall into the cabinet. Install sub-base by reversing removal procedure.

### **C. TANK FULL LIGHT**

To replace the Condensate Alarm Light on all models, disconnect the wires from the lamp and bend the tinnerman clip retaining light and pull out. Install new light, reversing the procedure.

### **D. CONDENSATE PUMP (ON ALL 5-TON UNITS OR ON UNITS WHERE THE CONDENSATE PUMP KIT HAS BEEN INSTALLED)**

1. Open condensate bucket access door located on lower right side panel and locate the condensate pump.
2. Remove brackets securing condensate pump in base pan, or condensate tank tray pan
3. Disconnect pump wire leads at Molex connectors. Remove retainer clamp and tubing.
4. Replace pump, install by reversing procedure.

### **E. HIGH PRESSURE SAFETY SWITCH**

1. Remove cabinets left hand side panel, or right rear side panel of Model 60.
2. Remove flare nut that secures capillary to the refrigeration system high pressure side. A Schrader valve is located in the discharge port, and allows removal without dumping the refrigerant charge.
3. Remove two screws that retain high pressure switch.
4. Disconnect wire leads from compressor contactor and condensate pump safety switch.
5. Install new High Pressure Control, reversing the procedure.

*To gain access to compressor and compressor run capacitor, remove left hand side panel.*

## **TROUBLESHOOTING GUIDE**

The following steps and procedures are recommended for correcting the problems indicated. In the event that the problem can not be corrected, service may be required.

### **SERVICE SHOULD BE PERFORMED BY A QUALIFIED AIR CONDITIONING SERVICE TECHNICIAN**

#### ***PROBLEM: UNIT DOES NOT POWER UP***

CAUSE: Power interruption

REMEDY: Check LCDI (on models with LCDI), and reset LCDI. Check external power supply making sure that the disconnect is ON. Check for blown fuses or tripped circuit breakers. Reset or replace if needed.

#### ***PROBLEM: NO DISPLAY ON THERMOSTAT***

CAUSE: Faulty thermostat or faulty transformer

REMEDY: Thermostat may be defective...remove and replace. Transformer may be defective...remove and replace.

#### ***PROBLEM: EVAPORATOR FAN RUNS BUT COMPRESSOR AND CONDENSER FAN DO NOT START***

CAUSE: Thermostat — setting may be too high.

REMEDY: Make sure set-point is lower than room temperature. You should see a snowflake "\*" designating that the thermostat is calling for cooling.

**Note—there is a 4 minute time delay for the compressor**

CAUSE: Thermostat—Loose wiring

REMEDY: Examine the control unit for loose wires. Tighten any loose connections.

CAUSE: Condensate Alarm—Check for Condensate Alarm Light.

REMEDY: Check condensate tank and empty tank or check condensate pump and make sure pump is working properly and that there is no kink in the drain line from the pump.

CAUSE: High Pressure Cut-out—Check High Pressure Cut-out Switch. Press Reset and clear away any obstructions to the condenser intake or condenser discharge.

CAUSE: Low Voltage — Check power supply for voltage outside the range of 106-126 volts on the 115 Volt unit and 187-253 Volts on the 208/230 Volt unit.

REMEDY: Have power checked by electrician and repaired.

CAUSE: Compressor contactor open or burned.

REMEDY: Replace contactor

## **PREVENTIVE MAINTENANCE**

AirBoss Spot Coolers are designed to last a long time and to give maximum performance and reliability with minimum maintenance. To prolong the life of the unit, regular maintenance must be performed as specified below:

### **BLOWER MOTORS**

The motors on all units have permanently lubricated bearings. No oiling is necessary

### **FILTERS**

A clogged filter will cause the unit to operate at greatly reduced efficiencies. We recommend that the filter be inspected on a regular bases every six weeks or more often depending on the environment. The evaporator filter is located behind the return air grille and can be easily removed and cleaned. The condenser filter is located in the lower backside of the unit. Remove by loosening one screw holding retaining clip and pull out. The filters must be washed periodically as needed by placing them in a dishwasher or soaking them in a solution of warm water and detergent for 10 minutes. Then rinsing them clean with hot water and shaking excess moisture from filter.

### **CONDENSATE PUMP**


Condensate pumps come standard on all Size 60 models, and may be installed as options on size 12, 18, 24 and 36 models. When servicing pump follow these steps;


1. Make certain that the unit is disconnected from the power source before attempting to service or remove any component.
2. Be sure the floats move freely. Clean as necessary.
3. Remove the volute and check for obstructions. Clean as needed.
4. Clean the tank with warm water and mild soap when mineral deposits are visible.
5. Check the inlet and outlet piping. Clean as necessary. Be sure there are no kinks in the lines that would inhibit flow.

### **GENERAL**

When necessary maintenance steps outlined above are followed, the air conditioner will provide long and reliable service. The refrigeration and electrical circuits of the system should only be serviced by a fully qualified service technician.


# PAC INTERIOR

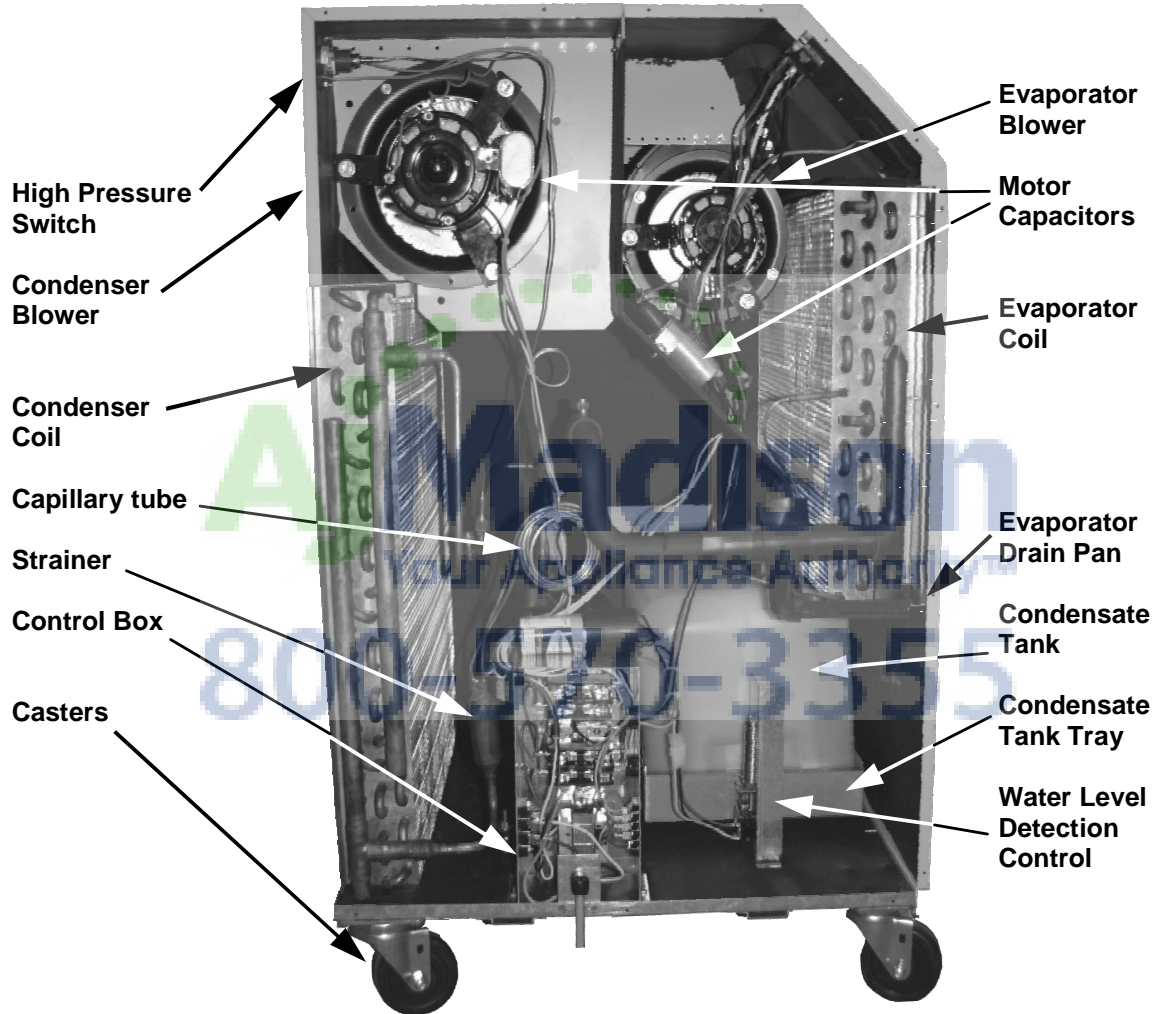

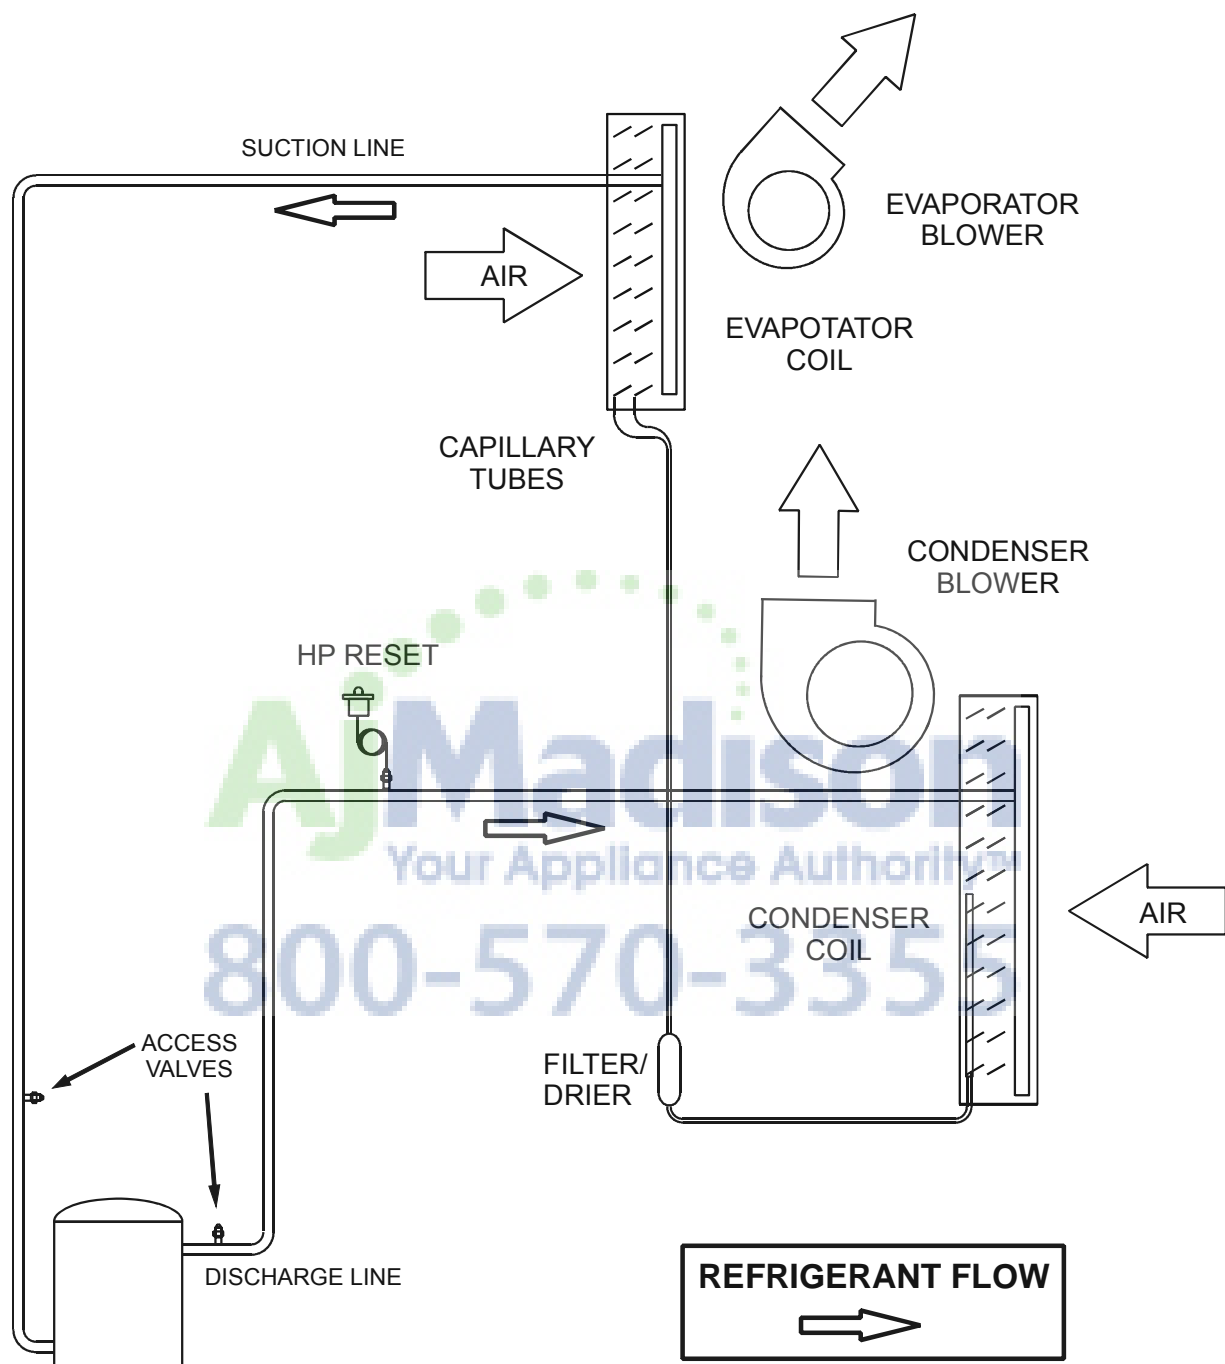


**PIPING SCHEMATIC**  
**Air-Cooled Spot Cooler**

# OCEANAIRE

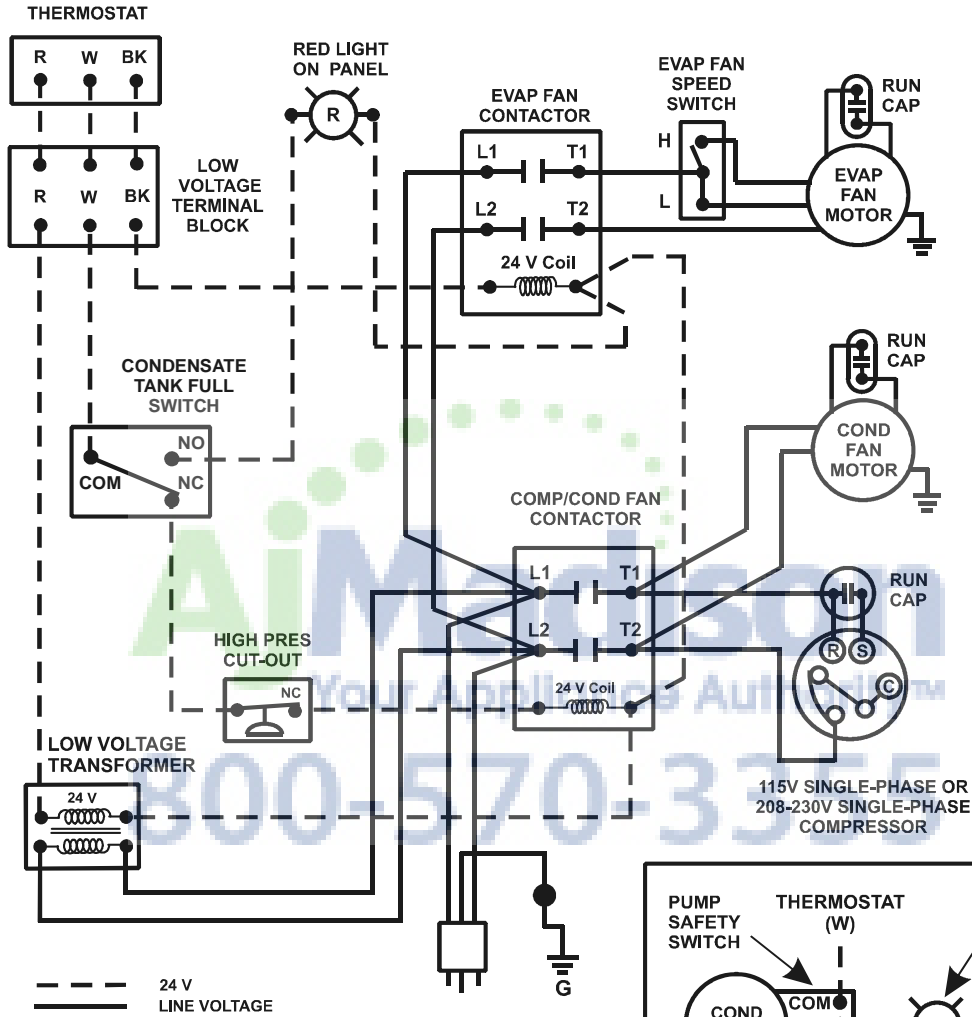


**AIR-COOLED SPOT COOLER**  
**MODELS PAC1211, PAC1811**  
**115V / SINGLE PHASE**  
**MODELS PAC2412, PAC3612**  
**208-230V / SINGLE PHASE**

051-005 WirePAC12-36  
 022010

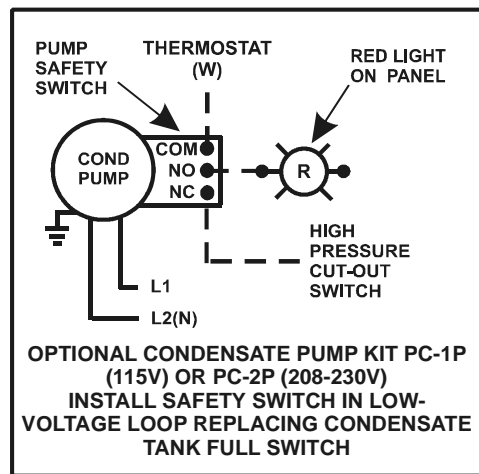

# OCEANAIRE


www.oceanaire-inc.com

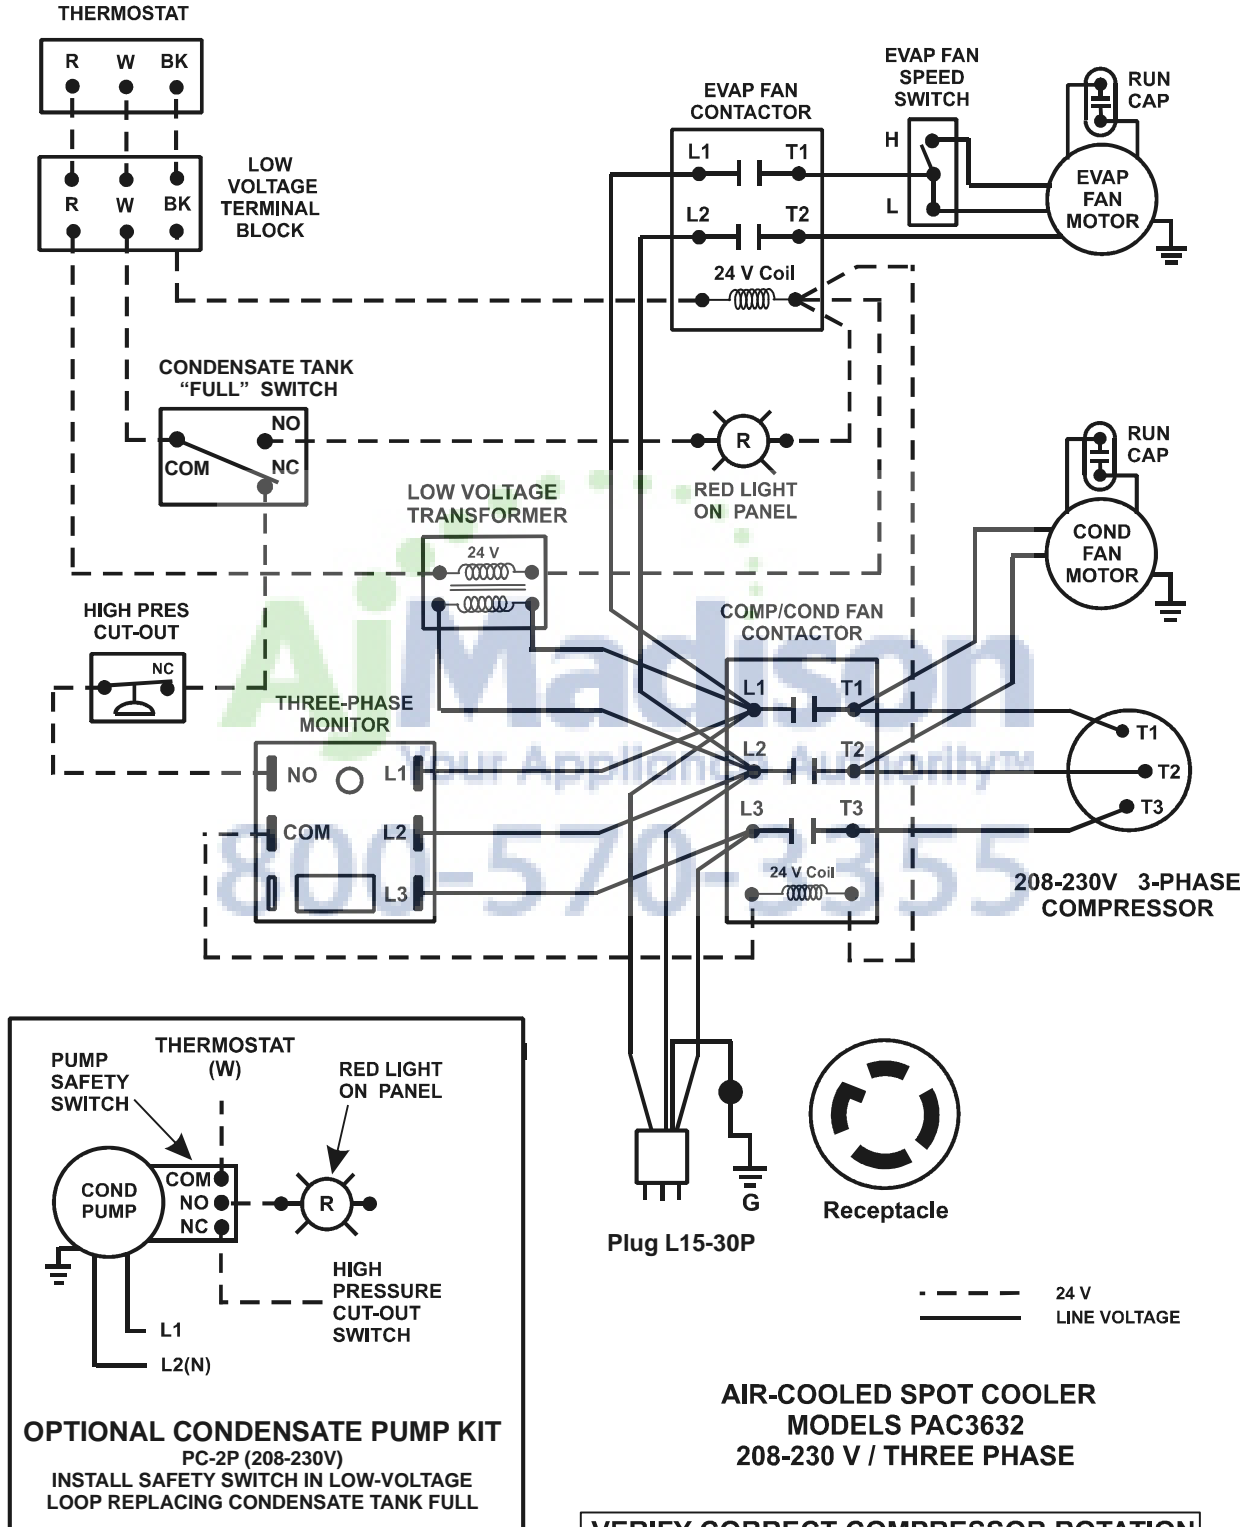


**VERIFY CORRECT COMPRESSOR ROTATION**


WirePAC3632  
052009



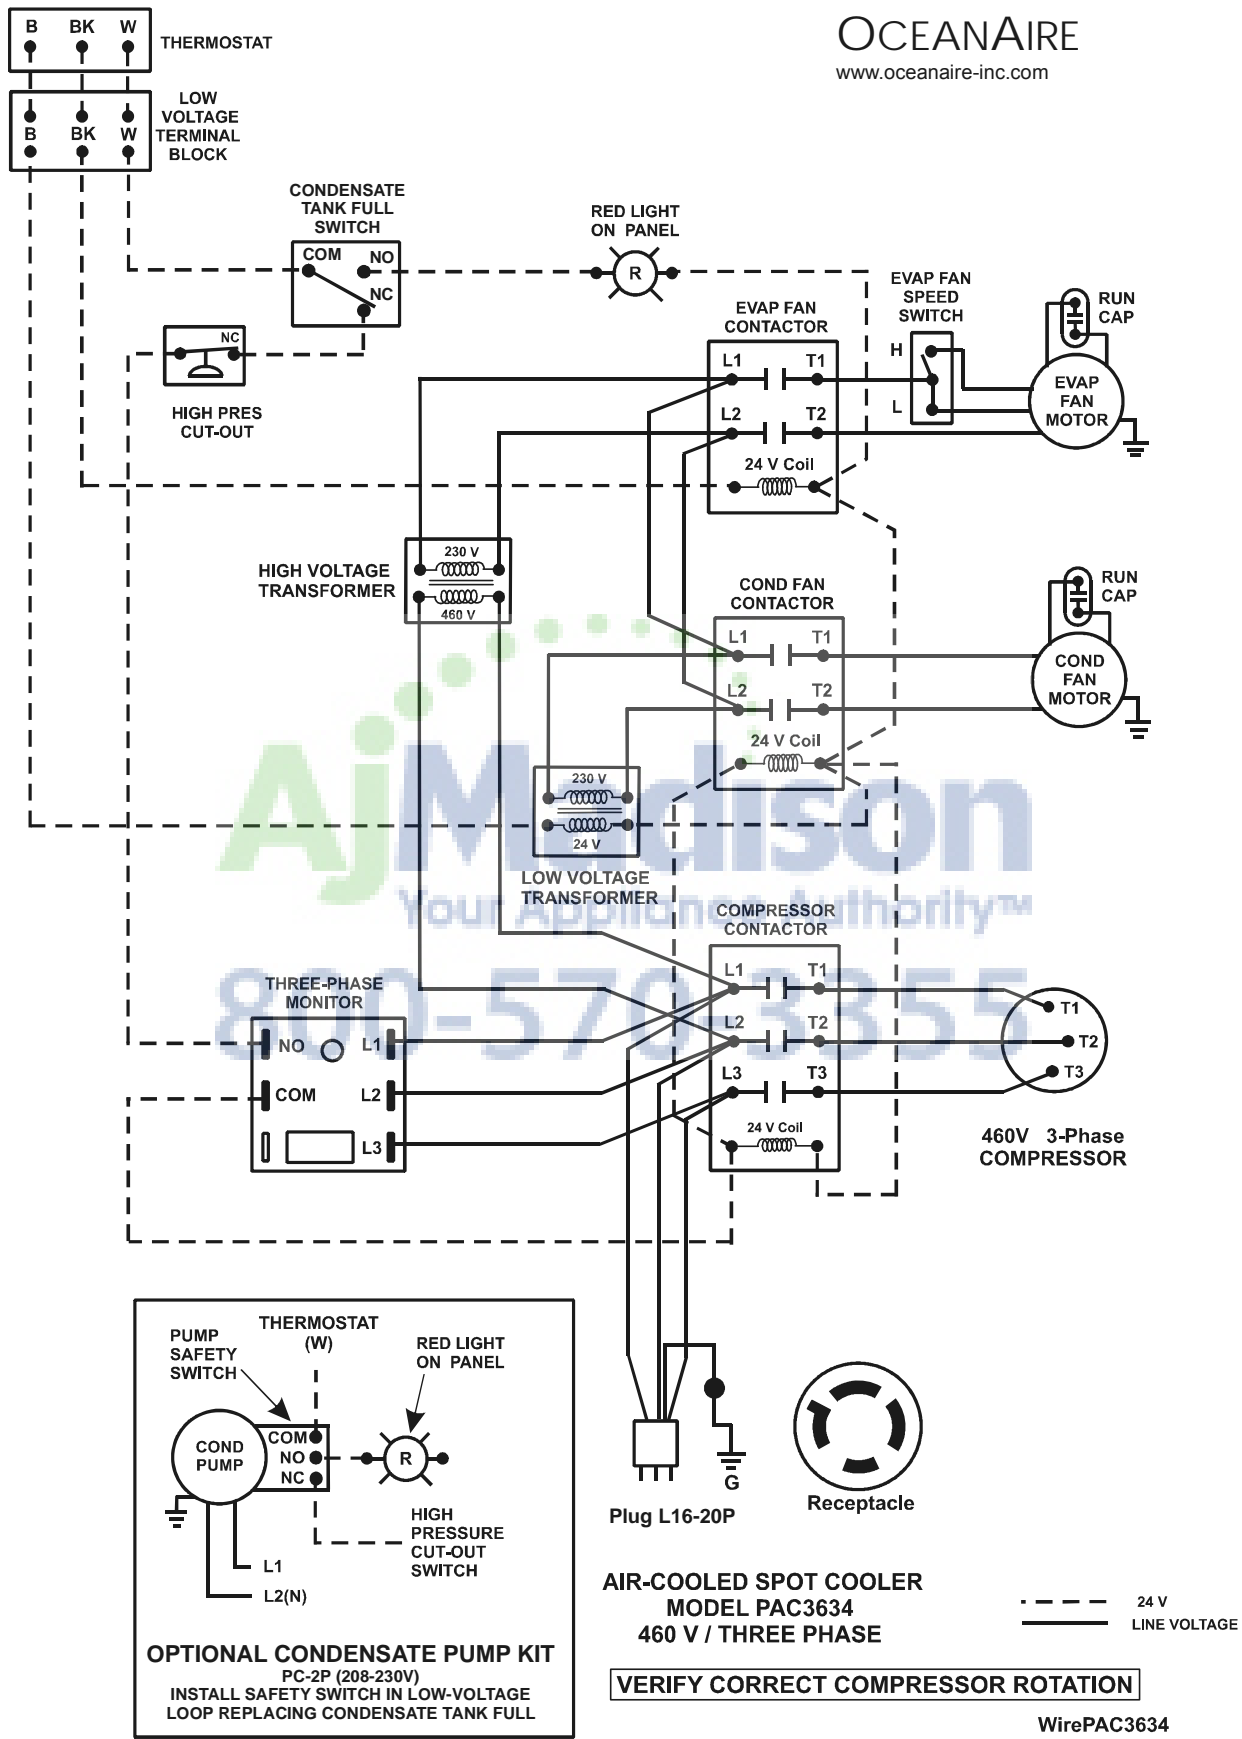


# OCEANAIRE

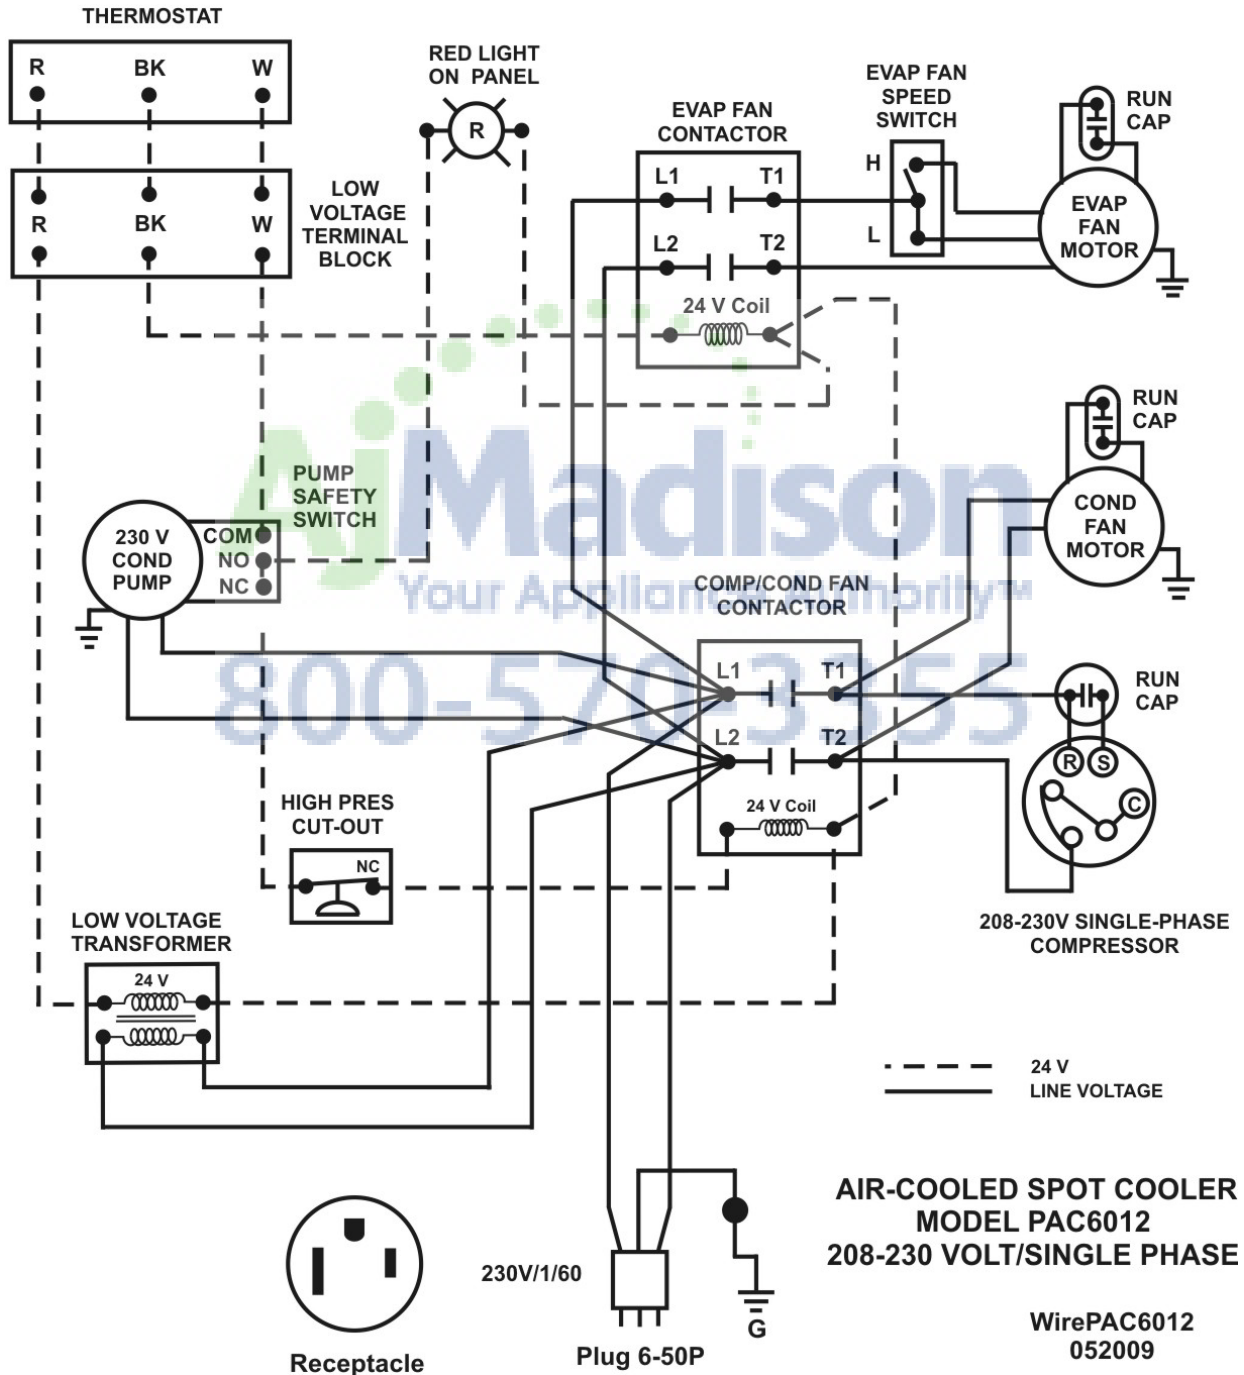

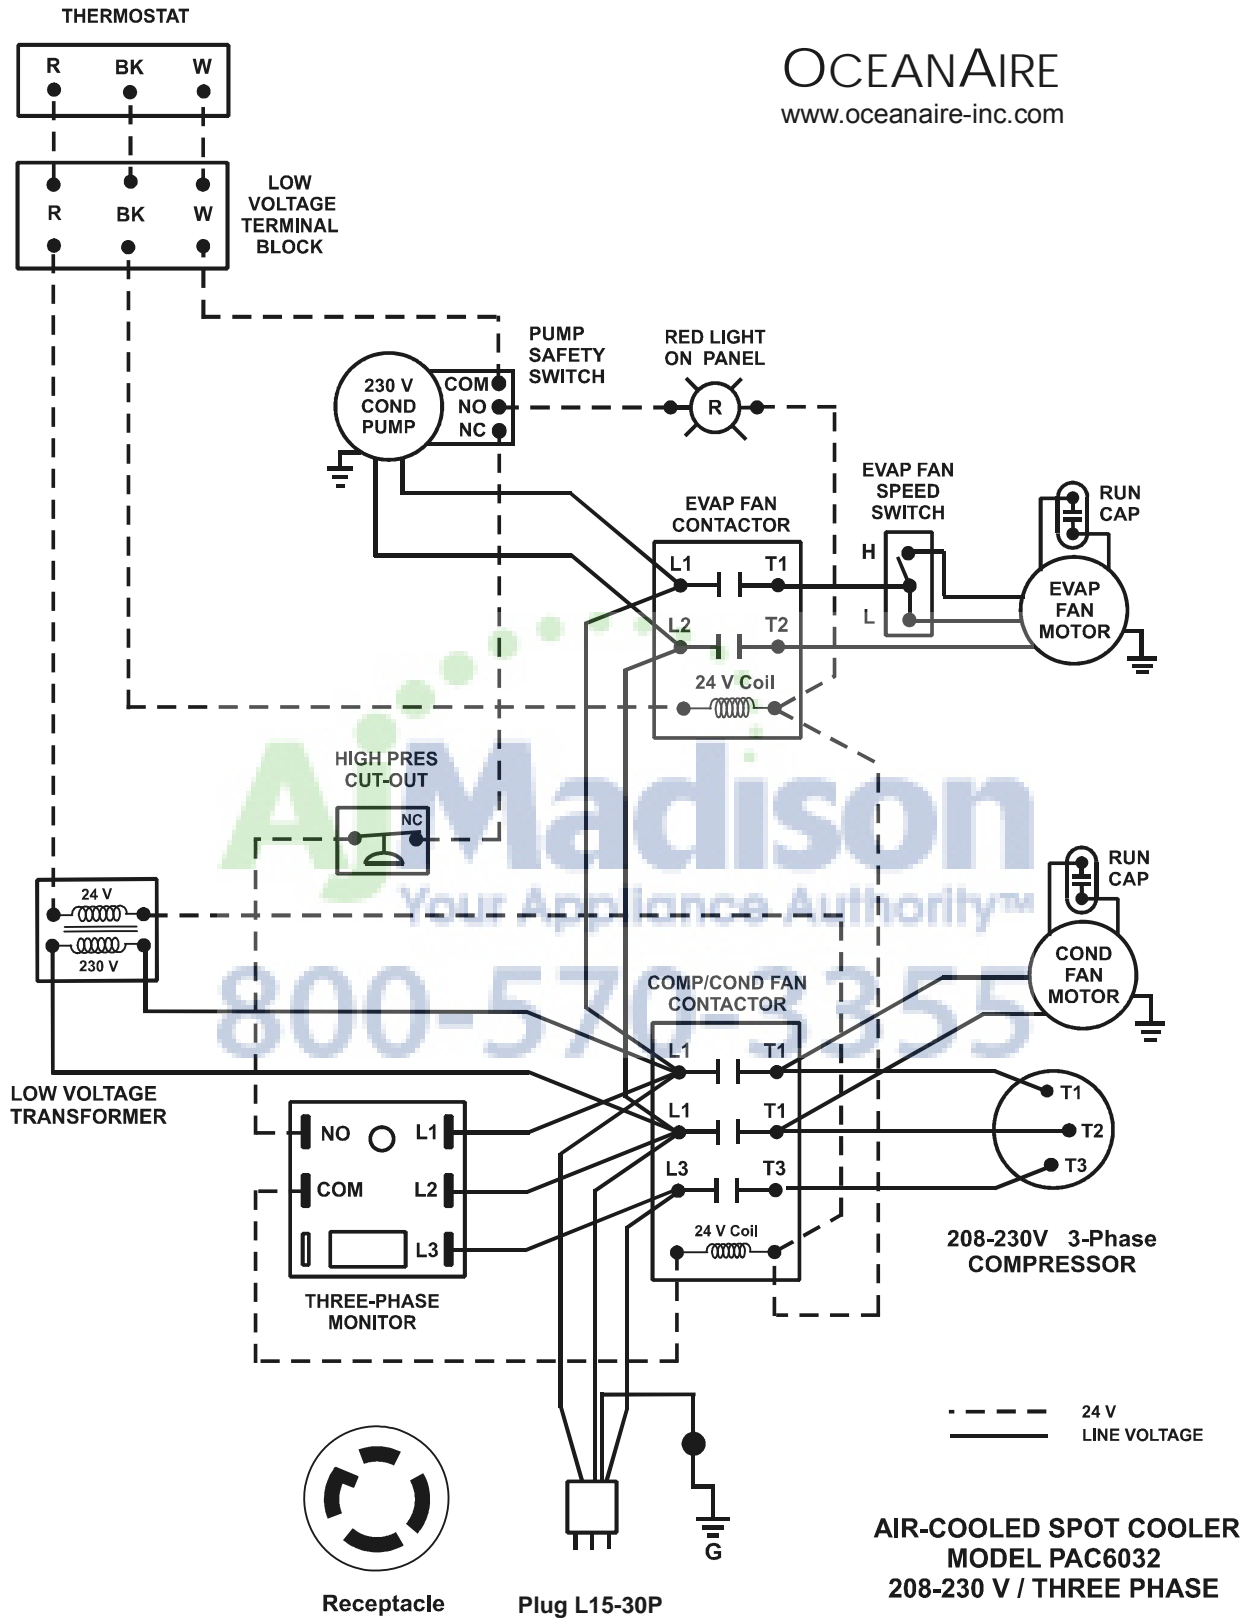

**VERIFY CORRECT COMPRESSOR ROTATION**

WirePAC6032  
052009

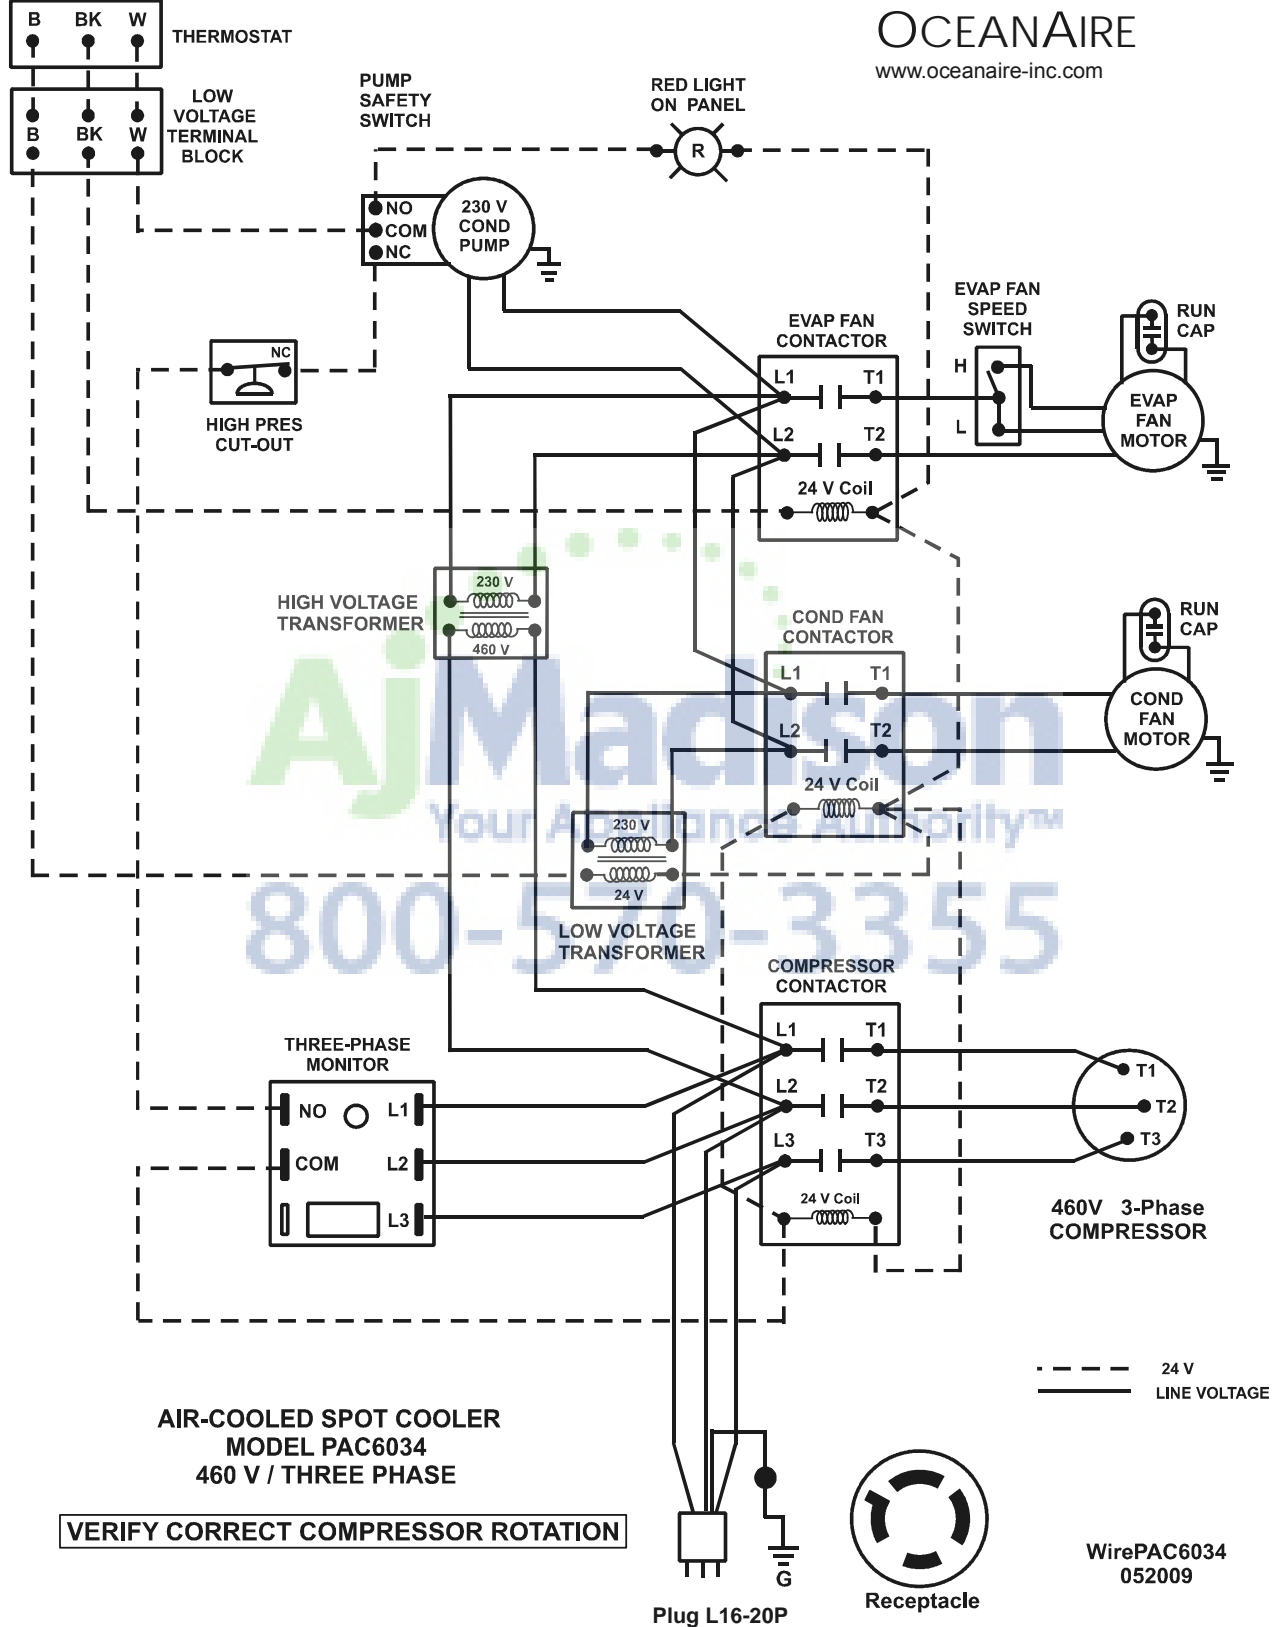

## **USE OF EXTENSION CORDS**

### **CAUTION:**

**FOR MODEL PAC1211** AN EXTENSION CORD CAN BE USED PROVIDED IT IS RATED AT LEAST 15 AMPS @ 115 VOLTS WITH GROUNDING-TYPE ATTACHMENT PLUG AND GROUNDING TYPE CONNECTOR (LOAD FITTING)

**FOR MODEL PAC1811** AN EXTENSION CORD CAN BE USED PROVIDED IT IS RATED AT LEAST 20 AMPS @ 115 VOLTS WITH GROUNDING-TYPE ATTACHMENT PLUG AND GROUNDING TYPE CONNECTOR (LOAD FITTING)

**FOR MODEL PAC2412** AN EXTENSION CORD CAN BE USED PROVIDED IT IS RATED AT LEAST 20 AMPS @ 250 VOLTS WITH GROUNDING-TYPE ATTACHMENT PLUG AND GROUNDING TYPE CONNECTOR (LOAD FITTING)

**FOR MODEL PAC3612** AN EXTENSION CORD CAN BE USED PROVIDED IT IS RATED AT LEAST 30 AMPS @ 250 VOLTS WITH GROUNDING-TYPE ATTACHMENT PLUG AND GROUNDING TYPE CONNECTOR (LOAD FITTING)

**FOR MODEL PAC6012** AN EXTENSION CORD CAN BE USED PROVIDED IT IS RATED AT LEAST 50 AMPS @ 250 VOLTS WITH GROUNDING-TYPE ATTACHMENT PLUG AND GROUNDING TYPE CONNECTOR (LOAD FITTING)

**FOR MODELS PAC3632 AND PAC6032** AN EXTENSION CORD MAY BEUSED PROVIDED IT IS RATED AT LEAST 30 AMPS @ 250 VOLTS, 3 PHASE

**FOR MODELS PAC3634 AND PAC6034** AN EXTENSION CORD CAN BE USED PROVIDED IT IS RATED AT LEAST 20 AMPS @ 600 VOLTS, 3 PHASE

### **SPECIAL NOTICE—THREE PHASE OPERATION**

#### **Models PAC3632, PAC3634, PAC6032 and PAC6034**

All three-phase CONVERTIBLEAIRE models are equipped with a three-phase monitor for added compressor protection. The phase monitor, located in the control box, has multi-color LED that reports status. The monitor protects the compressor from reverse operation, phase loss and low voltage situations. Further description of the three-phase monitor is located in the electrical section of the manual.

**NOTICE - DO NOT OPERATE ANY THREE-PHASE UNIT BY BY-PASSING THE MONITOR, THIS WILL VOID THE WARRANTY**

## Three Phase Monitor

Three-Phase units can be equipped with monitors for motor protection. The Oceanaire Three-phase Monitor safeguards the unit against incorrect compressor rotation, low-voltage and/or loss of power in any one of the power legs. The monitor is installed in the control box and is equipped with an LED for diagnosis of an improper electrical condition (see diagrams below). When power is connected, the thermostat WILL NOT power up, until the monitor start delay has been timed out. If the thermostat does not power up, an electrical condition may need to be addressed. Remove the control box cover and check the observe the LED on the phase monitor. The LED signals the following:


GREEN-BLINKING - Start delay, 120 sec.

GREEN - Proper Operation


RED/GREEN-BLINKING signals reverse phase rotation. Switch any two of the power leads for the unit, NOT THE MONITOR LEADS, and re-start.

RED-BLINKING signals improper voltage and/or phase loss. Correct the power problem, then re-start the unit.

In the event of a power interruption, the unit will re-set to a start-up condition. The Phase Monitor will not allow the unit to start until power is corrected.

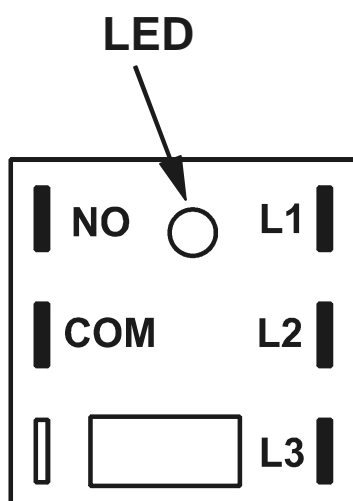

**THREE-PHASE  
MONITOR**

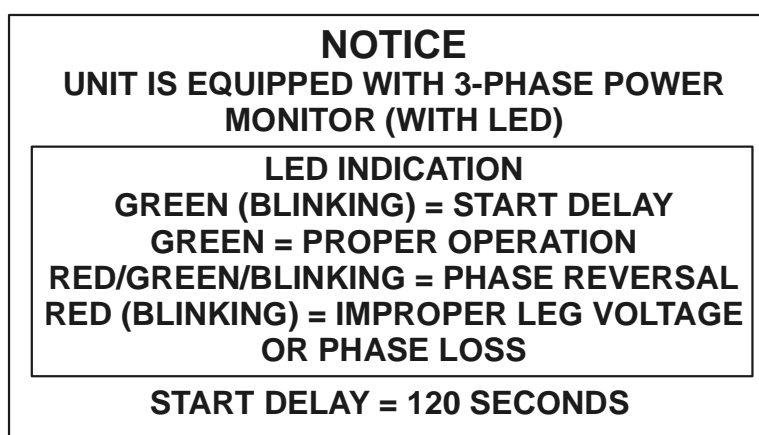

**CONTROL BOX LABEL**

## MANUFACTURER'S LIMITED WARRANTY

The Manufacturer (OceanAire, Inc.) warrants to the original owner that the Product will be free from defects in material or workmanship for a period not to exceed one (1) year from date of installation. If upon examination by the Manufacturer the Product is shown to have a defect in material or workmanship, during the warranty period, the manufacturer will repair or replace, at its option, that part of the Product which is shown to be defective.

The Manufacturer further warrants that the product's compressor-motor will be free from defects in materials and workmanship for five (5) years from the date of installation. If upon examination by the Manufacturer, the Compressor-Motor is shown to have a defect in materials or workmanship during the warranty period, the Manufacturer will repair or replace, at its option, that compressor which is shown to be defective. Electrical parts (such as relays, overloads, capacitors, etc.) and the sealed refrigeration system (condenser and evaporator) are included in the one year limited warranty, but not with the five year limited warranty of the compressor. This limited warranty does not apply:

- a) if the Product has been subjected to misuse or neglect, has been accidentally or intentionally damaged, has not been installed, maintained or operated in accordance with the furnished written instructions, or has been altered or modified in any way.
- b) to any expenses, including labor or material, incurred during removal or reinstallation of the Product.
- c) to any workmanship of the installer of the Product. This limited warranty is conditional upon:
  - (i) shipment, to the Manufacturer, of that part of the Product thought to be defective. Goods can only be returned with prior written approval from the Manufacturer. All returns must be freight prepaid.
  - (ii) determination, in the reasonable opinion of the Manufacturer that there exists a defect in material or workmanship.

Repair or replacement of any part under this Limited Warranty shall not extend the duration of the warranty with respect to such repaired or replaced part beyond the stated warranty period.

THIS LIMITED WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES, EITHER EXPRESS OR IMPLIED, AND ALL SUCH OTHER WARRANTIES, INCLUDING WITHOUT LIMITATION IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE, ARE HEREBY DISCLAIMED AND EXCLUDED FROM THIS LIMITED WARRANTY. IN NO EVENT SHALL THE MANUFACTURER BE LIABLE IN ANY WAY FOR ANY CONSEQUENTIAL, SPECIAL, OR INCIDENTAL DAMAGES OF ANY NATURE WHATSOEVER, OR FOR ANY AMOUNTS IN EXCESS OF THE SELLING PRICE OF THE PRODUCT OR ANY PARTS THEREOF FOUND TO BE DEFECTIVE. THIS LIMITED WARRANTY GIVES THE ORIGINAL OWNER OF THE PRODUCT SPECIFIC LEGAL RIGHTS. YOU MAY ALSO HAVE OTHER RIGHTS WHICH MAY VARY BY EACH JURISDICTION.

## USEFUL INFORMATION

MODEL: \_\_\_\_\_

SERIAL NUMBER: \_\_\_\_\_

DATE PURCHASED: \_\_\_\_\_

INSTALLED BY: \_\_\_\_\_



**For Technical Support, or to locate a distributor for service parts, contact Oceanaire at (847) 583-0311. Please indicate the Model Number and Serial Number of the unit to assure proper information and service parts.**